


MAIN CHARACTERISTICS

EMSPS is an absolute linear magnetostrictive transducer with SSI output. The main characteristic of magnetostrictive transducers is the absence of electric contact on the enclosure there is no issue of wear and deterioration during working life guaranteeing high displacement speed and precision. High reliability and simple installation even for applications with mechanical stresses, shocks or high contamination are assured by the compact size and the rugged enclosure.



ORDERING CODE	EMSPS	500	S	25	G	10	R5	P	A
	SERIES linear magnetostrictive transducer with SSI output EMSPS								
	STROKE mm from 50 to 1500 see table for stroke availability								
	ENCLOSURE RATING IP 67 S								
	DATA LENGTH (FM357) 21+1 bit 21 24 bit 24 25 bit 25								
	CODE TYPE binary B gray G								
	TRAVEL SPEED max 10 m/s 10								
	RESOLUTION 0,002 mm R2 0,005 mm R5 0,010 mm R10 0,020 mm R20 0,040 mm R40								
	OUTPUT TYPE cable (standard length 1 m) P DIN 45322 M16 6 pin connector C6 DIN 45326 M16 8 pin connector C8 M12 8 pin connector S8								
	OUTPUT DIRECTION axial A								

EMSPS

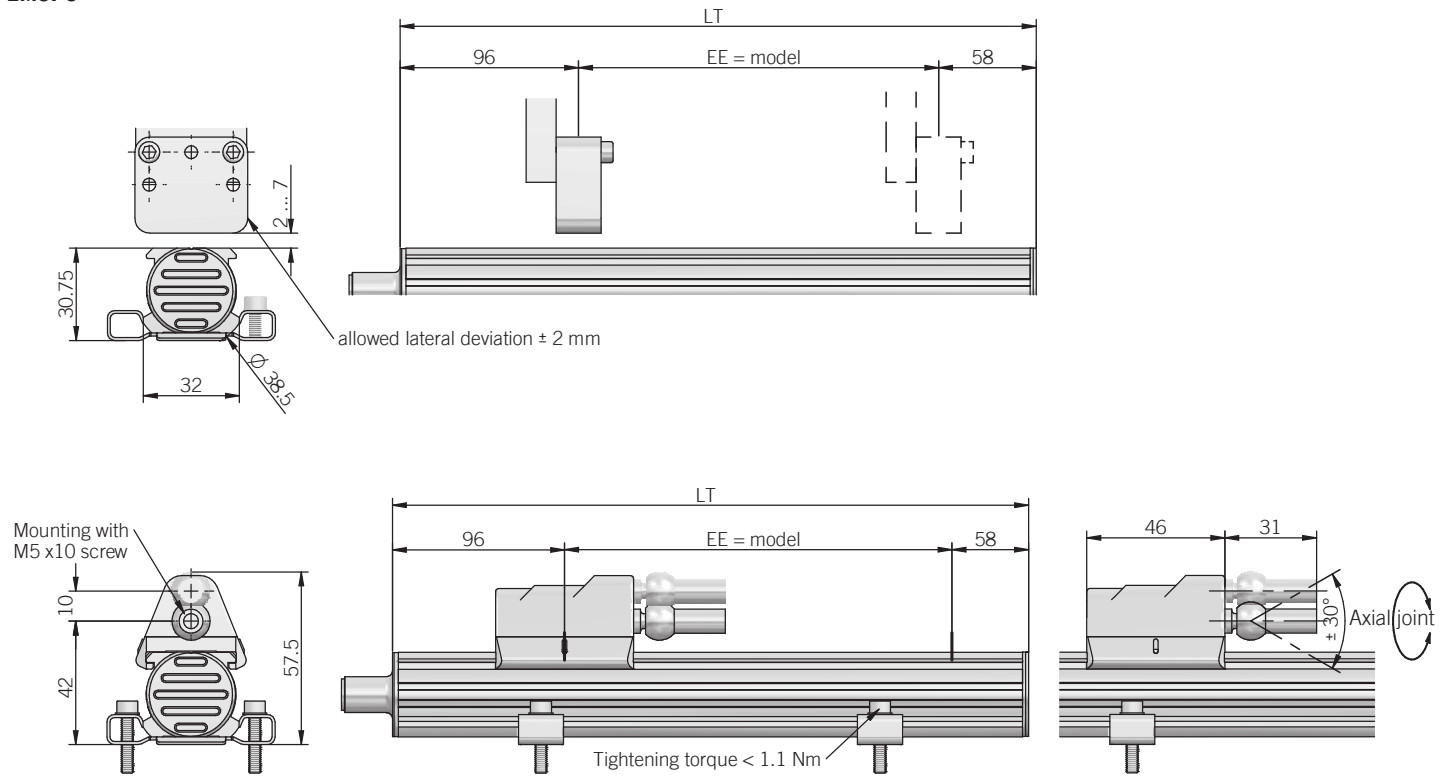

dimensions in mm

· brackets, cursors and socket connector not included, please refer to Accessories

ELECTRICAL SPECIFICATIONS	
Resolution	2 - 5 - 10 - 20 - 40 μ m
Independent linearity	$\leq \pm 0,01$ % FS (min $\pm 0,060$ mm) typical with sliding cursor $\leq \pm 0,02$ % FS typical with floating cursor
Repeatability	< 0,01 mm
Hysteresis	$\leq \pm 0,005$ % FS (min 0,010 mm)
Power supply¹	10 ... 32 V DC
Power ripple	1 Vpp max
Max load current	50 mA max
Electrical interface	RS-422
SSI output code	binary or gray
Clock frequency	50 kHz ... 1 MHz
SSI monostable time (Tm)	16 μ s
SSI frame	21 / 24 / 25 bit data length
Counting direction	increase
Protection against overvoltage	yes
Protection against polarity inversion	yes
Self-resetting internal fuse	yes
Electrical insulation	500 V DC (+V DC / earth)
Cable type	twisted pair shielded - fixed installation conductors section 0,22 mm ² / AWG 24 bending radius min 75 mm
Electromagnetic compatibility	according to 2014/30/EU directive
RoHS	according to 2011/65/EU directive

MECHANICAL SPECIFICATIONS	
Stroke	50 - 100 - 150 - 200 - 250 - 300 - 350 - 400 - 450 - 500 - 600 - 700 - 800 - 900 - 1000 - 1100 - 1200 - 1300 - 1400 - 1500 mm
Electric stroke (EE)	see stroke (mm)
Overall dimensions (LT)	EE + 154 mm
Enclosure rating	IP 67 (IEC 60529)
Detected measurement	displacement
Scale orientation	increasing
Travel speed	10 m/s max
Acceleration	100 m/s ² max
Shock	100 G, 11 ms, single shot (IEC 68000-2-27)
Vibration	12 G, 10 ... 2000 Hz (IEC 68000-2-6)
Housing material	anodized aluminium / Nylon 66 G 25
Cursor type	sliding or floating cursor
Temperature coefficient	20 ppm FS / °C
Operating temperature^{2,3}	-30° ... +90°C (-22° ... +194°F)
Storage temperature³	-40° ... +100°C (-40° ... +212°F)

¹ as measured at the transducer without cable influences

² measured on transducer

³ condensation not allowed


CONNECTIONS

Function	Cable P	8 pin M12 S8	6 pin M16 C6	8 pin M16 C8
+ V DC	blue / white	7	5	7
0 V	blue	6	6	6
DATA +	orange / white	2	2	2
DATA -	orange	5	1	5
CLOCK +	green / white	3	3	1
CLOCK -	green	1	4	3
NC	/	4	/	4
NC	/	8	/	8

S8 connector (8 pin)
M12 A coded
front view



C6 connector (6 pin)
DIN 45322
front view




C8 connector (8 pin)
DIN 45326
front view



The transducer enclosure and cable shield have to be connected to ground on both sides.

SSI BLOCK DIAGRAM

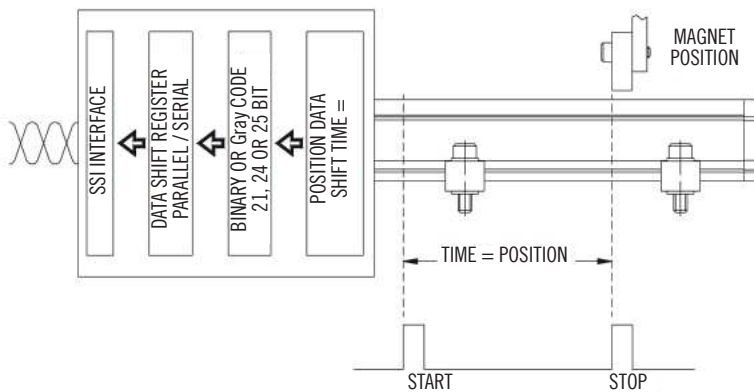


SSI output goes to 0 if the echo is absent (magnet out of measurement range or internal device error)

SSI CABLE LENGTH

Cable length	< 3 m	< 50 m	< 100 m	< 200 m	< 400 m
Baud rate	1 Mbaud	400 kbaud	300 kbaud	200 kbaud	100 kbaud

INSTALLATION EXAMPLE

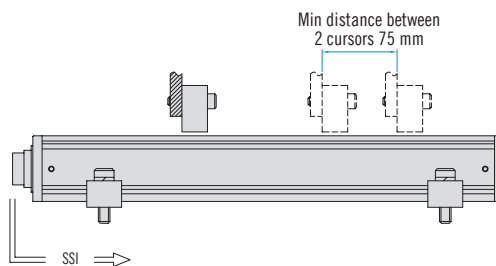

For multi-cursor model, the cursors have to work in the same conditions of distance and temperature. Cursors must be installed on a support made of non-magnetic material (like brass, aluminium or AISI316 stainless steel). The installation kit provides two screws, two nuts and two washers (all made of brass). The cursor must be installed with maximum attention to horizontal alignment with the transducer axis (maximum tolerance is ± 2 mm), distance from the transducer surface has to be within the range from 2 to 7 mm.